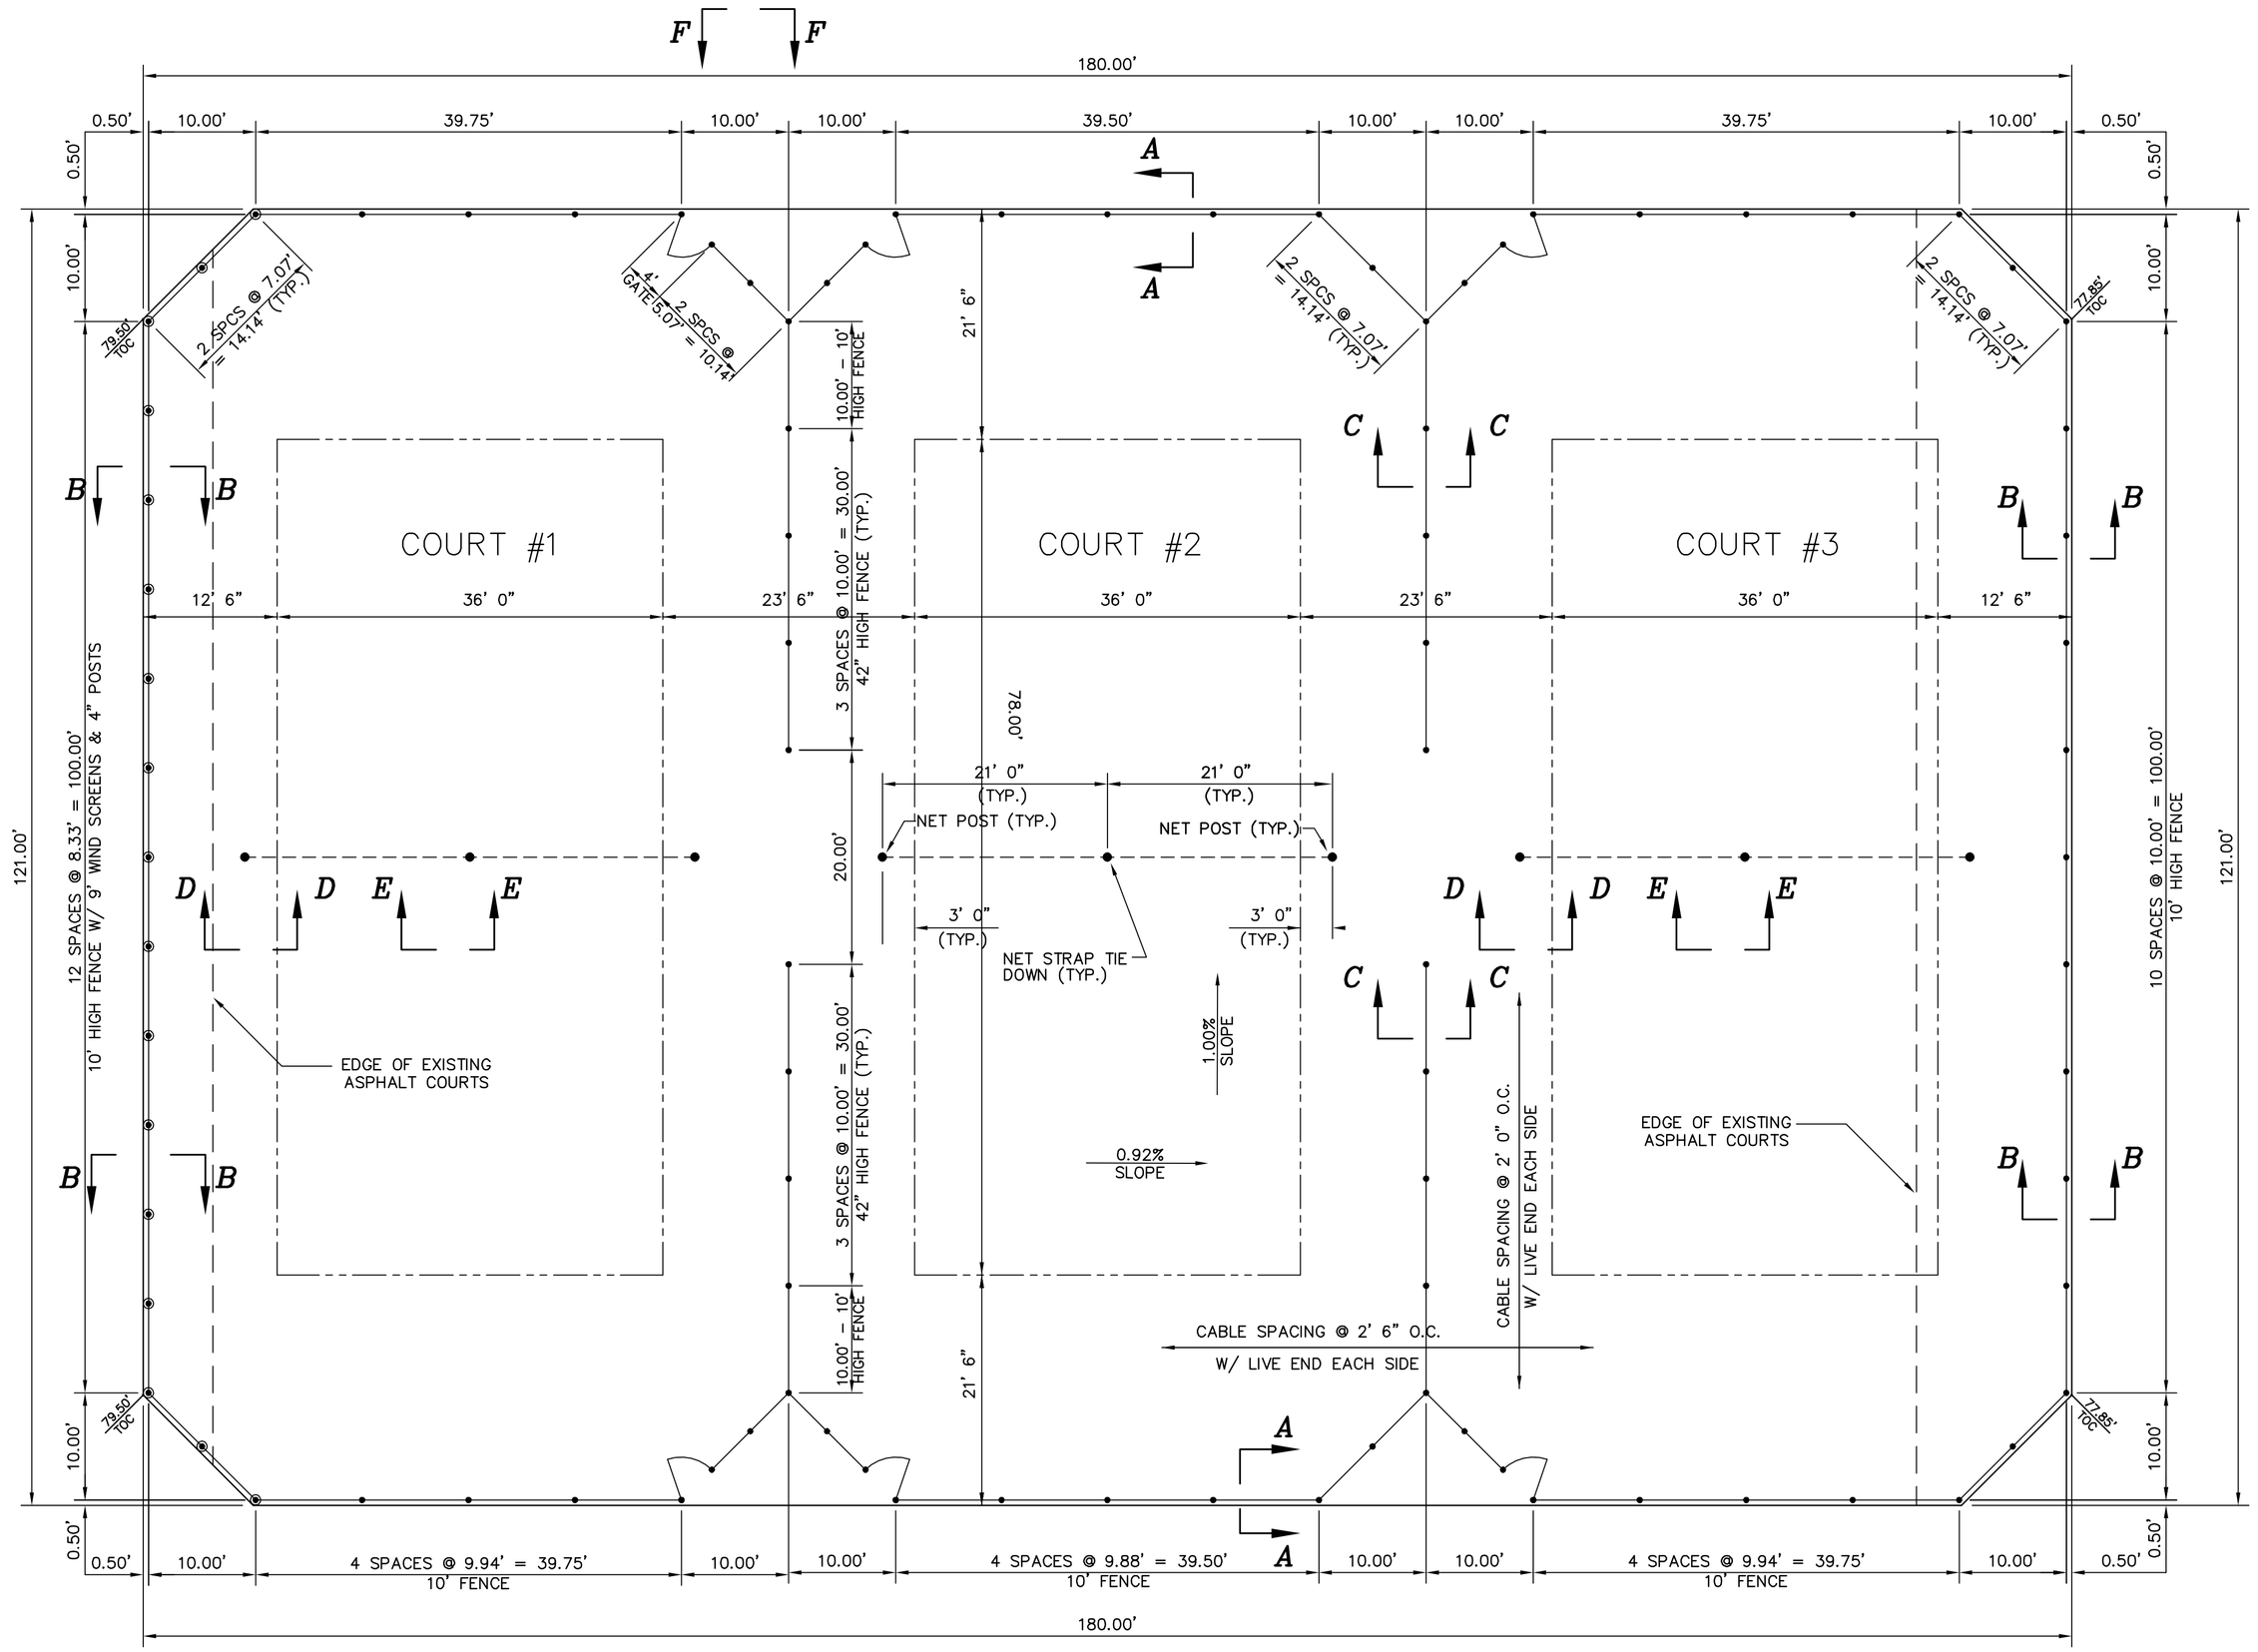

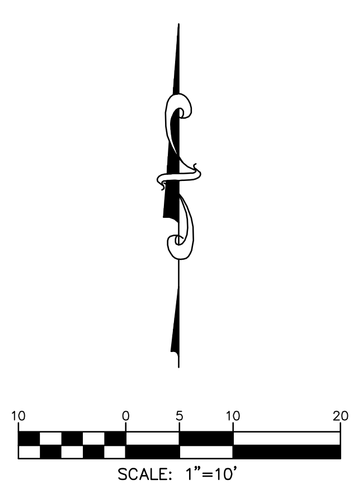

NOTES:

1. ALL CONCRETE WILL BE A MINIMUM OF 4000 PSI STRENGTH AT 28 DAYS, NON FIBERMESH.
2. SUBGRADE WILL BE PREPARED IN ACCORDANCE WITH THE GEOTECHNICAL REPORT DONE BY BUCKHOEN GEOTECH DATED JULY 28, 2014, PROJECT # 14-195-GEO AS STATED ON PAGE 3 ON OF THE REPORT IN REFERENCE TO THE SITE PREPARATION AND GRADING.
3. ADEQUATE DRAINAGE AWAY FROM THE SLAB IS REQUIRED. A MINIMUM OF 6 INCH DROP IN THE FIRST 5 FEET AWAY FROM THE SLAB ON ALL SIDES.
4. ALL #4'S SHALL HAVE A MINIMUM SPLICE LENGTH OF 24".
5. ALL PT CABLES AND REBAR WIIL HAVE A MINIMUM 3" CLEARANCE FROM EDGE OF SLAB
6. ALL FENCE POSTS DESIGNATED WITH "◉" ARE 4" DIAMETER AND ALL OTHER POSTS ARE 2 7/8" DIAMETER
7. THE 4" FENCE POSTS ON THE WEST SIDE ARE DESIGNED FOR 9' WIND SCREEN AND ALL OTHER 2 7/8" POSTS ON THE NORTH, SOUTH AND EAST SIDES ARE NOT DESIGNED FOR ANY WIND SCREENS.

KENNETH W. SCHMIDT REGISTERED 9/03/2014 11150 PROFESSIONAL ENGINEER & LAND SURVEYOR STATE OF COLORADO

REVISIONS

DATE

PROJECT: CRESTED BUTTE TENNIS COURTS
CRESTED BUTTE, COLORADO

DRAWING: TENNIS COURT LAYOUT PLAN

CLIENT: RENNER SPORTS SURFACES

DESIGNED BY: K.W.S.
DRAWN BY: K.W.S.
CHECKED BY: K.W.S.

SCALE: HORZ: 1"=10'
VERT: N/A
DATE: 9/03/2014

KWS
ENGINEERING & DEVELOPMENT CONSULTANTS
1580 LINCOLN STREET SUITE 770
DENVER, CO 80203
PHONE: (303) 832-1377
FAX: (303) 832-1569

SHEET NUMBER
1

PROJECT No. 2014-28

SHT 1 OF 3 SHTS

CRESTE BUTTE CTS - 01.DWG